



Testing. Advising. Assuring.

Test report No. 2014-1276

for applying of a required "Verwendbarkeitsnachweis"
issued 14.03.2014

Applicant: Gabriel A/S
Hjulgagervej 55
DK-9000 Aalborg

Date of order: 28.02.2014
Date of sampling: *no official sampling of the specimen by a representative of Exova Warringtonfire, Frankfurt*
Date of arrival: 28.02.2014
Date of test: 14.03.2014

Order

Testing of the flammability (building class B1) according to DIN 4102-1 (May 1998)

Description / designation of the test object

Fabric designated as „Art. Fame with Flovan“

Description of the relevant test procedure

DIN 4102 part 1 (Mai 1998)

This test report did not replace the required „Verwendbarkeitsnachweis“. It is only used for issuing the "Verwendbarkeitsnachweis".

1. Description of the test material

1.1 Details of the customer:

Fabric designated as „Art. Fame with Flovan”

Sample description:

Col.: 61003
Comp.: 95/5 % Wool/Pa
Designno.: 960461003
Design decrip.: Fame/61003 Flovan/*
Order No.: 3045920

1.2 At the specimen preparation by Exova Warringtonfire, Frankfurt determined values:

Fabric

Colour: brown
Thickness: 1 mm (average)
Weight per unit area: 490 g/m² (average)

Testing after storing 14- days under climatic conditions (23°C / 50 % rel. humidity).

2. Test results

2.1.1 Brandschachtprüfung according to DIN 4102-1

Sample A: Material tested in production direction

Sample B: Material tested crosswise to the production direction

Test results of the Brandschacht tests part 1						
line no.		Measurements test sample				
			A	B	C	D
1	<u>no. test arrangement according to DIN 4102 part 15, table 1</u>					
2	<u>flame height max. over lower sample edge</u> time ¹⁾	cm	70	80		
		min : s	0:26	0:23		
3	<u>ascertainties on the front side</u> Flaming/glowing time ¹⁾	min : s	0:05	0:06		
4	<u>melting / burning through</u> time ¹⁾	min : s	0:20	0:19		
5	<u>ascertainties on the back side</u> Flaming/glowing time ¹⁾ discolouring time ¹⁾	min : s	0:20	0:19		
6		min : s	no	no		
7	<u>burning droplets</u> begin ¹⁾ extent occasional dropping of material constant dropping of material	min : s	not	not		
8			occured	occured		
9						
10	<u>separating from burning sample parts</u> begin ¹⁾ occasional separating parts constant separating parts	min : s	not	not		
11			occured	occured		
12						
13	duration of burning on the sieve tray (max.)	min : s	not	not		
	influence on the burner flame by dropping of / separating material time ¹⁾		no	no		
14		min : s				
15	<u>earlier end of test</u> end of the fire scenario on the sample ¹⁾ time of a possible resulted test stop ¹⁾	min : s	no	no		
16		min : s				

¹⁾ time from start of test

Test results of the Brandschacht tests part 2							
line no.		Measurements test sample					
			A	B	C	D	
17	<u>flaming after end of test</u> duration	min : s	not occured	not occured			
18	number of sample		--/--	--/--			
19	front side of sample	cm	--/--	--/--			
20	backside of sample		--/--	--/--			
21	flame length		--/--	--/--			
22	<u>glowing after end of test</u> duration	min . s	not occured	not occured			
23	number of sample		--/--	--/--			
24	place of occurrence lower sample part		--/--	--/--			
25	upper sample part		--/--	--/--			
26	front side of sample		--/--	--/--			
27	backside of sample		--/--	--/--			
28	<u>smoke density</u> < 400 % x min			30	39		
29	> 440 % x min			--/--	--/--		
30	diagram in annex no.		-	-			
31	<u>residual length</u> single results	cm	55 / 56 53 / 51	53/ 51 52 / 51			
32	average of the single results	cm	53	51			
33	foto of the sample on page		5	5			
34	<u>smoke temperature</u> max. of the average results	°C	144	155			
35	time ¹⁾	min : s	0:28	0:32			
36	diagram in annex no.		1	2			

¹⁾ time from start of test

Remarks: Because of the residual length of > 45 cm in two tests, the quantity of tests could be reduced, according to DIN 4102-16.

2.1.2 Appearance of the specimen after the test:



Sample A



Sample B

2.2.1 Normal flammability test according to DIN 4102-1

Test with edge ignition without deposit
 Flame application on: lower sample edge
 Edge ignition

Length direction

Sample-no.	1	2	3	4	5
Time from start of test					
Ignition point [s]	1	1	1	1	1
Reaching the measuring mark within 20 seconds	no	no	no	no	no
Self extinguishing of the flame [s]	15	15	10	15	15
Max. flame height [mm]	50	50	30	50	50
Time [s]	15	15	10	15	15
End of afterflaming [s]	-	-	-	-	-
End of afterglowing [s]	-	-	-	-	-
Flames extinguished after [s]	-	-	-	-	-
Smoke development (visuell impression)	moderate smoke production				
Separating from burning material	no	no	no	no	no
Time [s]	-	-	-	-	-


Remarks: none

Cross direction

Sample-no.	1	2	3	4	5
Time from start of test					
Ignition point [s]	1	1	1	1	1
Reaching the measuring mark within 20 seconds	no	no	no	no	no
Self extinguishing of the flame [s]	15	15	15	15	15
Max. flame height [mm]	50	50	50	50	50
Time [s]	15	15	15	15	15
End of afterflaming [s]	-	-	-	-	-
End of afterglowing [s]	-	-	-	-	-
Flames extinguished after [s]	-	-	-	-	-
Smoke development (visuell impression)	moderate smoke production				
Separating from burning material	no	no	no	no	no
Time [s]	-	-	-	-	-

Remarks: none

Appearance of the sample after the small burner test:

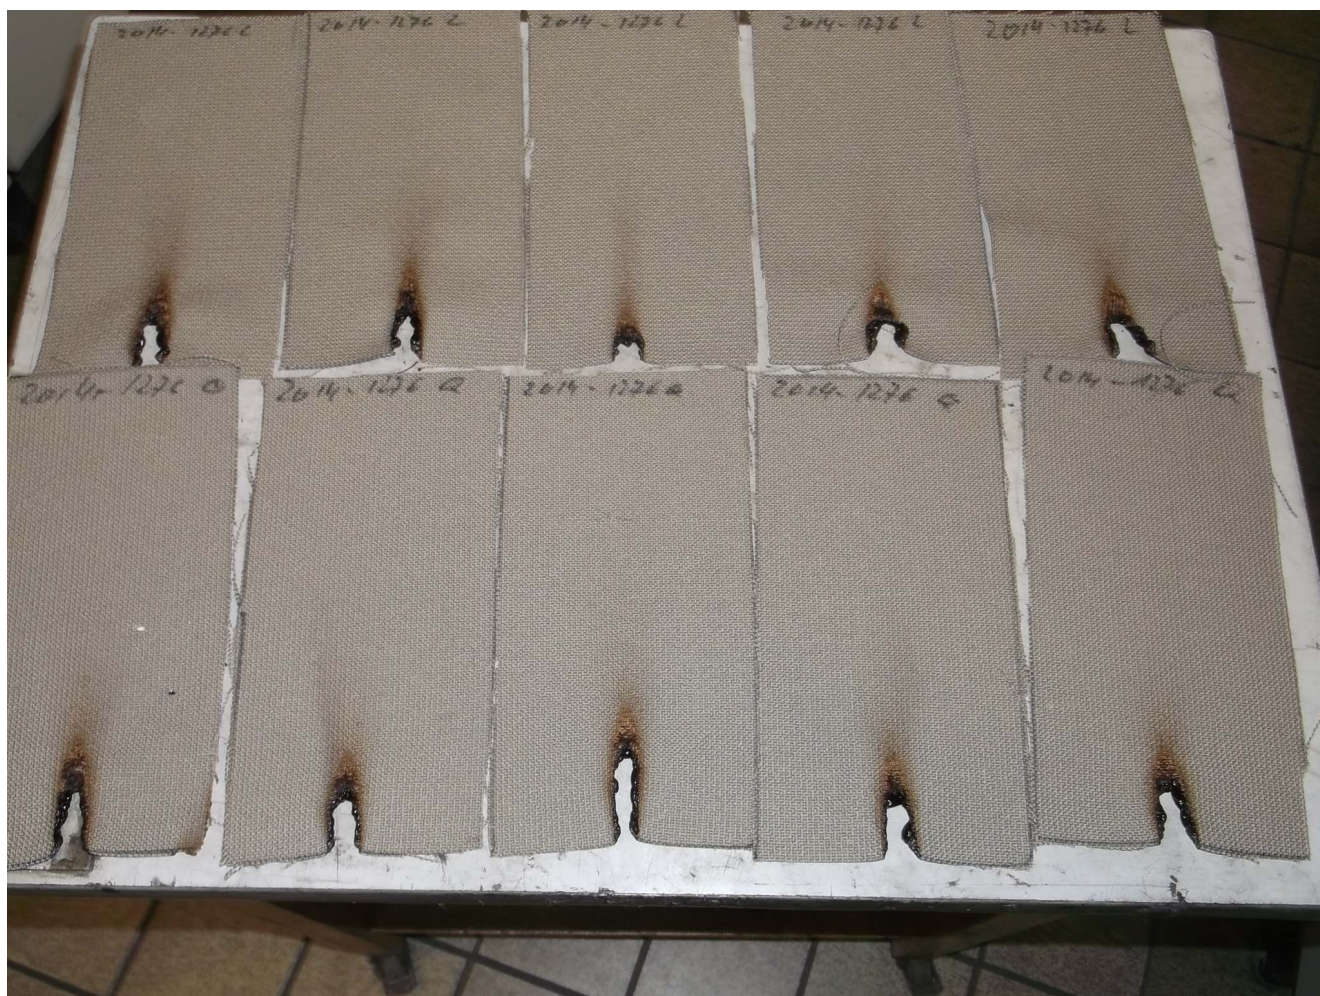

Assessment

The material, described in chapter one fulfils the requirements of the building class B2 according to DIN 4102-1 (Mai 1998).

The determined test results show that the material also fulfils the requirements

of the building class B1

according to DIN 4102-1 (Mai 1998).

Special comment

The fire test result is only valid for the material described in chapter one, in free hanging conditions, in the tested colours and parameters (thickness, weight per unit area).

The distance to other plane material must be more or equal then 40 mm.

The material wasn't tested after an outside storage.

In combination with other materials (for example coatings, deposits) the burning behaviour could be influenced unfavourable so that the classification above is not valid any longer. According to DIN 4102-1 the burning behaviour in combination with other materials has to be tested separately.

This test report did not replace the required „Verwendbarkeitsnachweis“. It is only used for issuing the “Verwendbarkeitsnachweis”.

Frankfurt, the 14.03.2014



P. Scheinkönig
Tester in charge



Dipl.-Ing. H. Bräuer
Head of the test laboratory

This Test report is valid until 13.03.2019

The results of the tests relate only to the behaviour of the test specimen which is designated on the top.

Test reports are only allowed to be published or reproduced, not changed in form and tenor without permission of the Exova Warringtonfire, Frankfurt. The abridged account of a test report is only allowed with the agreement of the Exova Warringtonfire, Frankfurt.



This test report is a translation of the German version 2014-1103 (issued 14.03.2014). In case of doubt only the German version is valid

This test report contains 8 pages and 2 annexes.

Testing. Advising. Assuring.

Annex 1 to the Test report No. 2014-1276 issued 14.03.2014

Sample A:

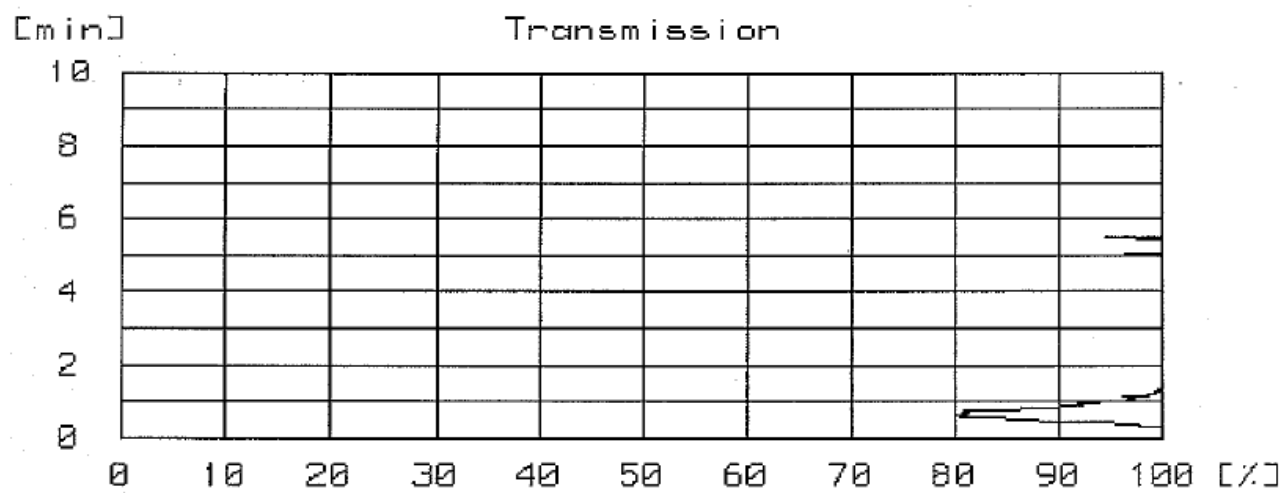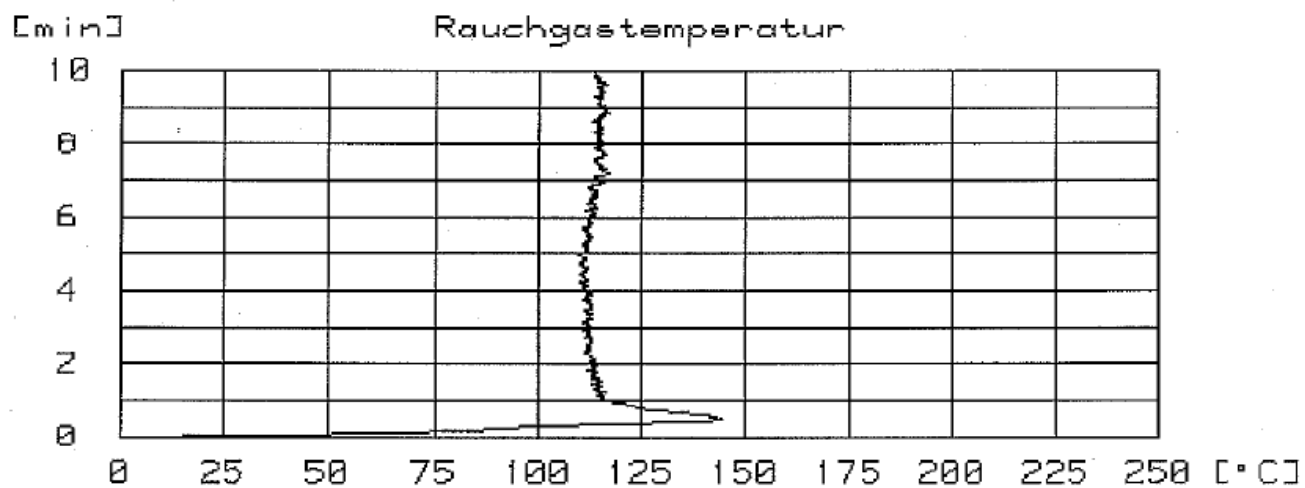

Testing. Advising. Assuring.

Annex 2 to the Test report No. 2014-1276 issued 14.03.2014

Sample B:

